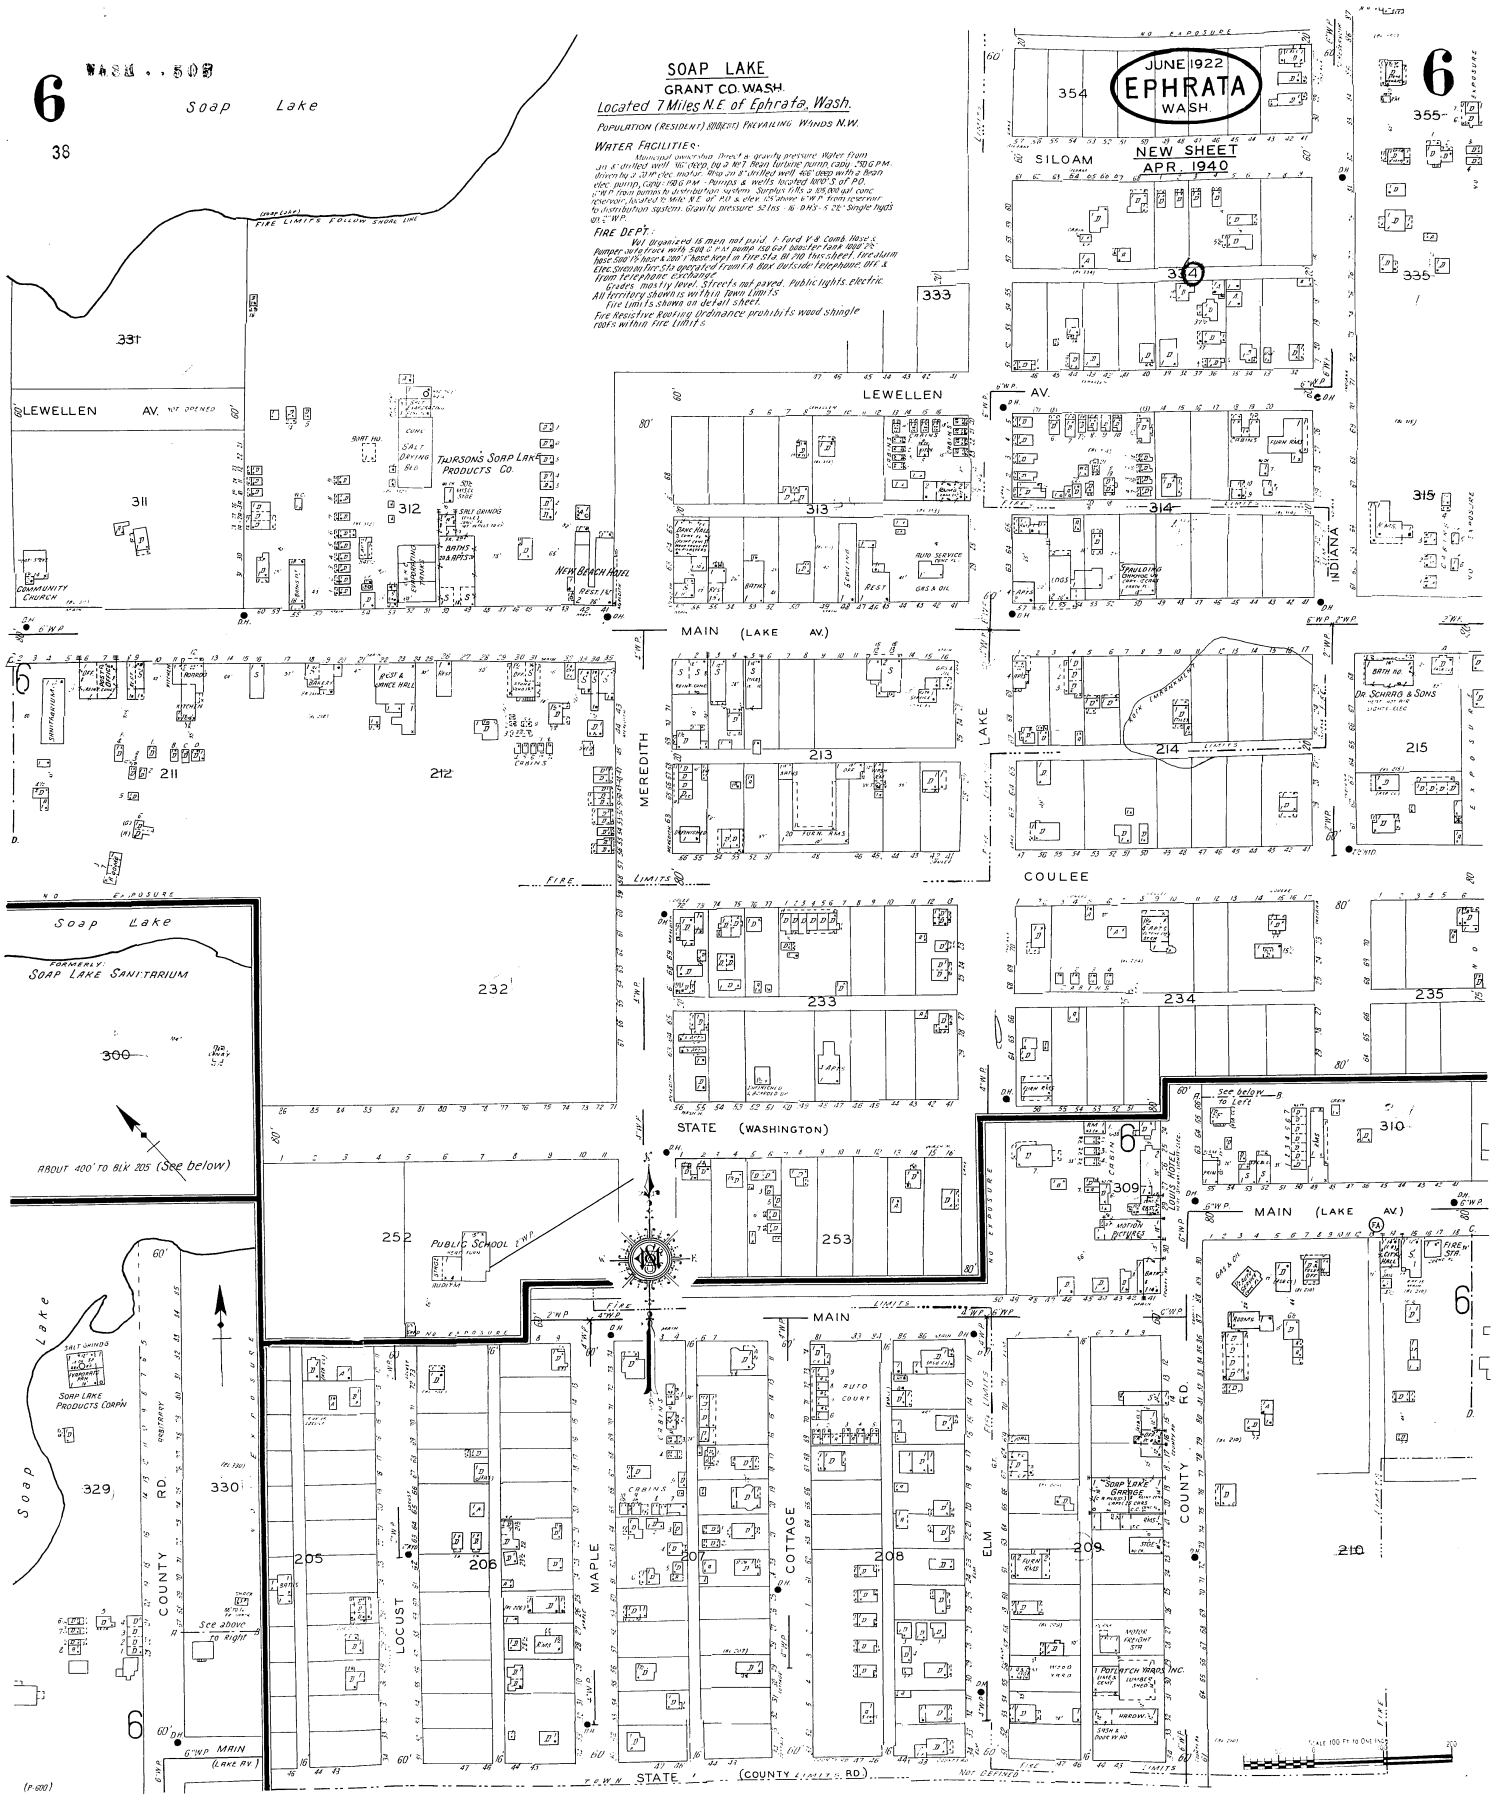
6
WASH. . 508
38
SOAP LAKE
GRANT CO. WASH.
Located 7 Miles N.E. of Ephrata, Wash.
POPULATION (RESIDENT) 1000 BEAT PREVAILING WINDS N.W.
WATER FACILITIES:-
Municipal ownership. Direct & gravity pressure. Water from 3 drilled well 360' deep, by a No 7 Bean turbine pump, cap. 750 G.P.M. driven by a 30 HP elec. motor. Also an 8" drilled well 400' deep with a Bean elec. pump, cap. 150 G.P.M. - Pumps & wells located 1000' S. of P.O. 6" W.P. from pumps to distribution system. Surplus fills a 105,000 gal. conc. reservoir, located 1/2 Mile N.E. of P.O. & elev. 125 above 6" W.P. from reservoir to distribution system. Gravity pressure 52 lbs. - 16 D.H.S. - 5 2/2" Single hyds on 6" W.P.
FIRE DEPT.:-
Vol. organized 15 men not paid. 1 Ford V 8 Comb. Hose & Pumper auto truck with 500 G.P.M. pump. 150 Gal. Booster tank 1000' 2½" hose. 500' 1½" hose & 200' 1" hose kept in Fire Sta. Bl. 210 this sheet. Fire alarm Elec. Shed on Fire Sta. operated from F.A. Box. Outside telephone. Off & from telephone exchange.
Grades mostly level. Streets not paved. Public lights, electric.
All territory shown is within Town Limits.
Fire Limits shown on detail sheet.
Fire Resistive Roofing Ordinance prohibits wood shingle roofs within Fire Limits.
JUNE 1922
EPHRATA
WASH.
NEW SHEET
APR. 1940
Soap Lake
FIRE LIMITS FOLLOW SHORE LINE
LEWELLEN AV.
THORSONS SOAP LAKE PRODUCTS CO.
NEW BEACH HOTEL
COMMUNITY CHURCH
SILOAM
MAIN (LAKE AV.)
MEREDITH
LAKE
INDIANA
COULEE
STATE (WASHINGTON)
FIRE LIMITS
Soap Lake
FORMERLY: SOAP LAKE SANITARIUM
ABOUT 400' TO BLK 205 (See below)
PUBLIC SCHOOL
MAIN
MAPLE
COTTAGE
ELM
COUNTY RD.
LOCUST
SOAP LAKE PRODUCTS CORP'N
SOAP LAKE GARAGE
POTLATCH YARDS INC.
STATE (COUNTY LIMITS RD.)
NOT DEFINED
SCALE 100 FT. TO ONE INCH
(P-600)